
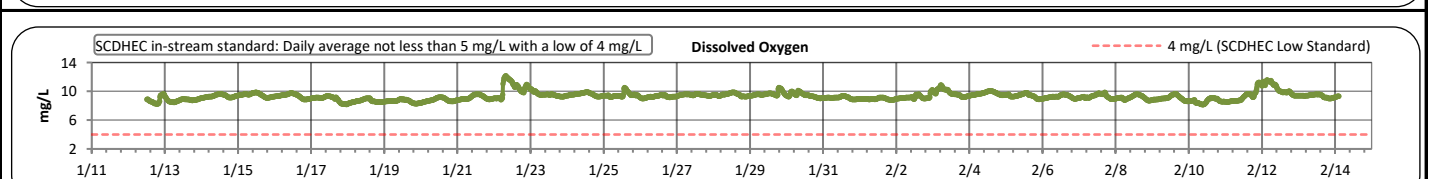
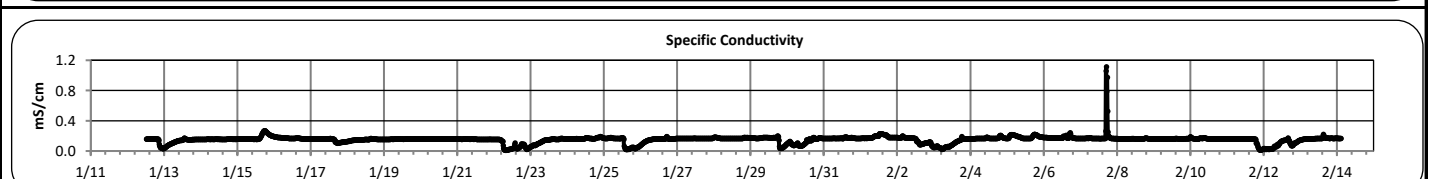
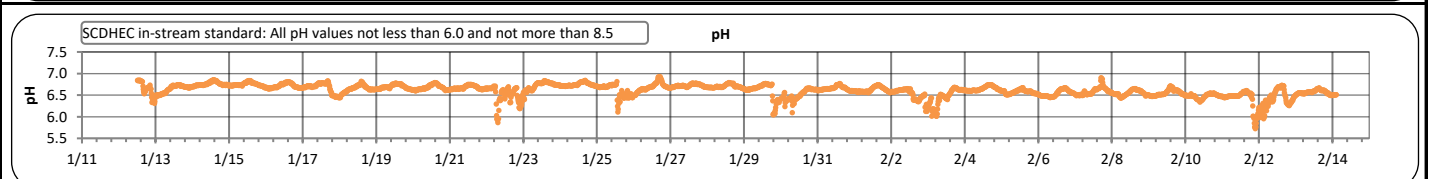
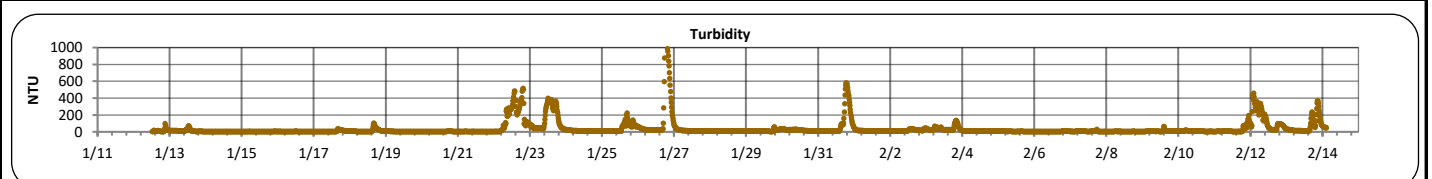
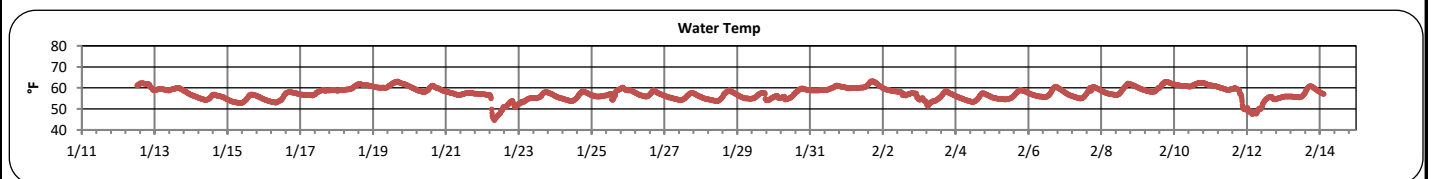


Continuous Water Quality Monitoring Periodic Report

Rocky Branch A (January 11, 2023 - February 15, 2023)

PARAMETER	DESCRIPTION	CONTINUOUS WATER QUALITY PARAMETERS:	SUMMARY STATISTICS				
			MINIMUM OBSERVED	MAXIMUM OBSERVED	MEDIAN OBSERVED	MEAN OBSERVED	STANDARD DEVIATION
STREAM NAME:	Rocky Branch	STAGE (FT):	1.4	4.1	1.5	1.5	0.3
LOCATION:	Maxcy Gregg Park	TEMPERATURE (°F):	45	63	57	57	3
ADDRESS:	1650 Park Circle Columbia, SC 29201	TURBIDITY (NTU):	5	990	9	36	85
COORDINATES:	33.995864, -81.021842	pH:	5.7	6.9	6.6	6.6	0.1
TMDL/IMPAIRMENT:	Fecal Coliform	SPECIFIC CONDUCTIVITY (mS/cm):	0.011	1.114	0.162	0.152	0.050
NEIGHBORING LANDUSE:	Residential and commercial	DISSOLVED OXYGEN (mg/L):	8.2	12.2	9.3	9.3	0.6
SPATIAL LOCATION:	Most upstream site						
TOTAL NO. STORMS OVER 0.1 INCH:	9						
MAX. DAILY RAINFALL:	2.1 inches						
TOTAL RAINFALL (FOR PERIOD):	7.1 inches						

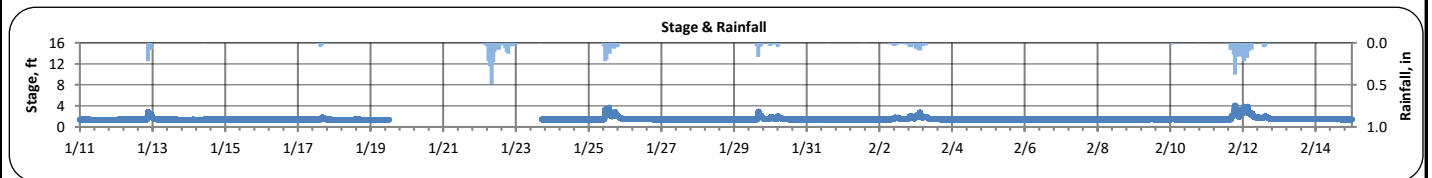

Note: Data gaps appear when the sonde is removed for calibration or when the flow depth is below the sensors

REPORT GENERATED ON 4/20/2023

**Continuous Water Quality
Monitoring Periodic Report**

Rocky Branch A (January 11, 2023 - February 15, 2023)

Explanation of Statistics:

MINIMUM OBSERVED	The minimum of the values recorded by the datasonde in 15 minute intervals.
MAXIMUM OBSERVED	The maximum of the values recorded by the datasonde in 15 minute intervals.
MEDIAN OBSERVED	The median of all the values recorded by the datasonde in 15 minute intervals.
MEAN OBSERVED	The average of all the values recorded by the datasonde in 15 minute intervals.
STANDARD DEVIATION	The standard deviation of all the values recorded by the datasonde in 15 minute intervals.

Sampled Data:

Analyte (units)								
	Time	Results	Time	Results	Time	Results	Time	Results
<i>Escherichia coli</i> (MPN/100mL)								
Total Suspended Solids (mg/L)								
Total Phosphorus (mg/L)								
Total Nitrogen (mg/L)								

No samples were collected during this monitoring period.

Notes:

Data Gaps

There was a gap in stage data on 1/19 to 1/23, which was likely due to equipment communication failure.

Potential Illicit Discharges and Abnormal Events:

Specific conductivity increased several times during the monitoring period, which may have been a result of the Maxcy Gregg pool discharge.


Note: Data gaps appear when the sonde is removed for calibration or when the flow depth is below the sensors

REPORT GENERATED ON 4/20/2023

Continuous Water Quality Monitoring Periodic Report

Rocky Branch B (January 11, 2023 - February 15, 2023)

PARAMETER	DESCRIPTION	CONTINUOUS WATER QUALITY PARAMETERS:	SUMMARY STATISTICS				
			MINIMUM OBSERVED	MAXIMUM OBSERVED	MEDIAN OBSERVED	MEAN OBSERVED	STANDARD DEVIATION
STREAM NAME:	Rocky Branch	STAGE (FT):	3.3	7.3	3.5	3.6	0.4
LOCATION:	Olympia Ave Crossing	TEMPERATURE (°F):	45	63	55	55	4
ADDRESS:	510 Heyward St Columbia, SC 29201	TURBIDITY (NTU):	4	726	12	29	47
COORDINATES:	33.982578, -81.035036	pH:	6.5	7.8	7.2	7.2	0.2
TMDL/IMPAIRED:	Fecal Coliform	SPECIFIC CONDUCTIVITY (mS/cm):	0.012	0.331	0.175	0.162	0.044
NEIGHBORING LANDUSE:	Residential and commercial	DISSOLVED OXYGEN (mg/L):	7.5	12.1	9.4	9.4	0.7
SPATIAL LOCATION:	Most Downstream Site						
TOTAL NO. STORMS OVER 0.1 INCH:	7						
MAX. DAILY RAINFALL:	2.0 inches						
TOTAL RAINFALL (FOR PERIOD):	6.6 inches						

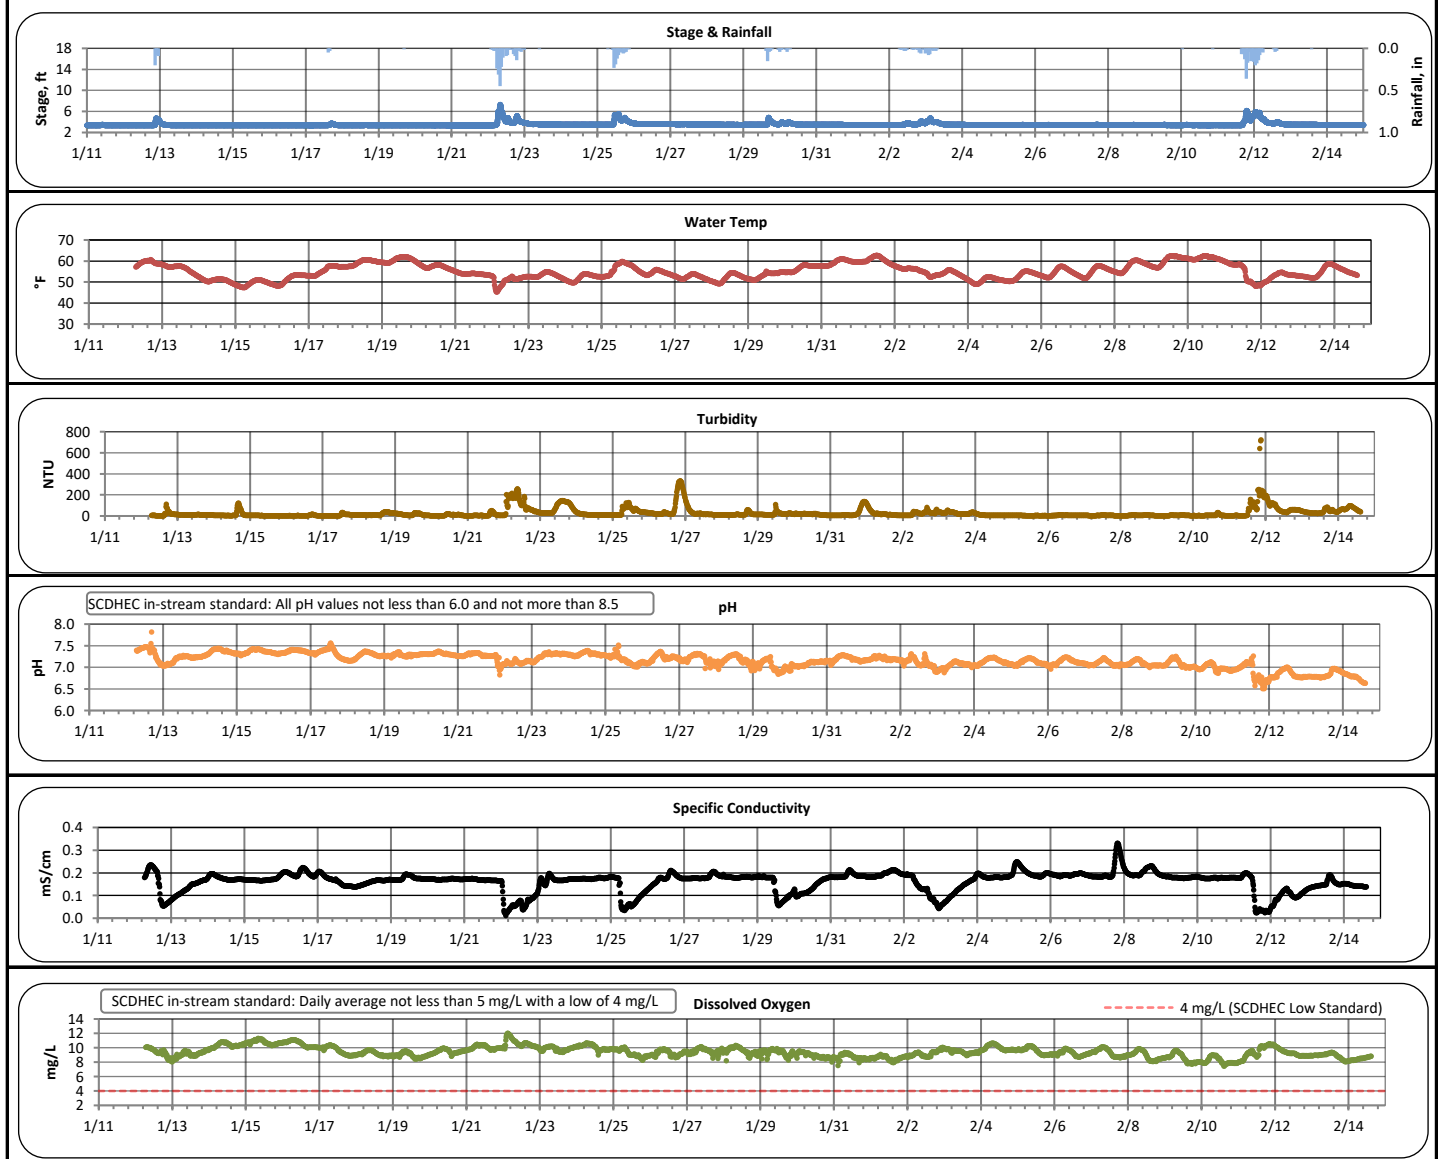

Note: Data gaps appear when the sonde is removed for calibration or when the flow depth is below the sensors

REPORT GENERATED ON 4/20/2023

**Continuous Water Quality
Monitoring Periodic Report**

Rocky Branch B (January 11, 2023 - February 15, 2023)

Explanation of Statistics:

MINIMUM OBSERVED	The minimum of the values recorded by the datasonde in 15 minute intervals.
MAXIMUM OBSERVED	The maximum of the values recorded by the datasonde in 15 minute intervals.
MEDIAN OBSERVED	The median of all the values recorded by the datasonde in 15 minute intervals.
MEAN OBSERVED	The average of all the values recorded by the datasonde in 15 minute intervals.
STANDARD DEVIATION	The standard deviation of all the values recorded by the datasonde in 15 minute intervals.

Sampled Data:

Analyte (units)								
	Time	Results	Time	Results	Time	Results		
<i>Escherichia coli</i> (MPN/100mL)								
Total Suspended Solids (mg/L)								
Total Phosphorus (mg/L)								
Total Nitrogen (mg/L)								

No samples were collected during this monitoring period.

Notes:

Data Gaps

There were no data gaps during this monitoring period.

Potential Illicit Discharges and Abnormal Events:

Specific conductivity increased several times during the monitoring period, which may have been a result of the Maxcy Gregg pool discharge.